
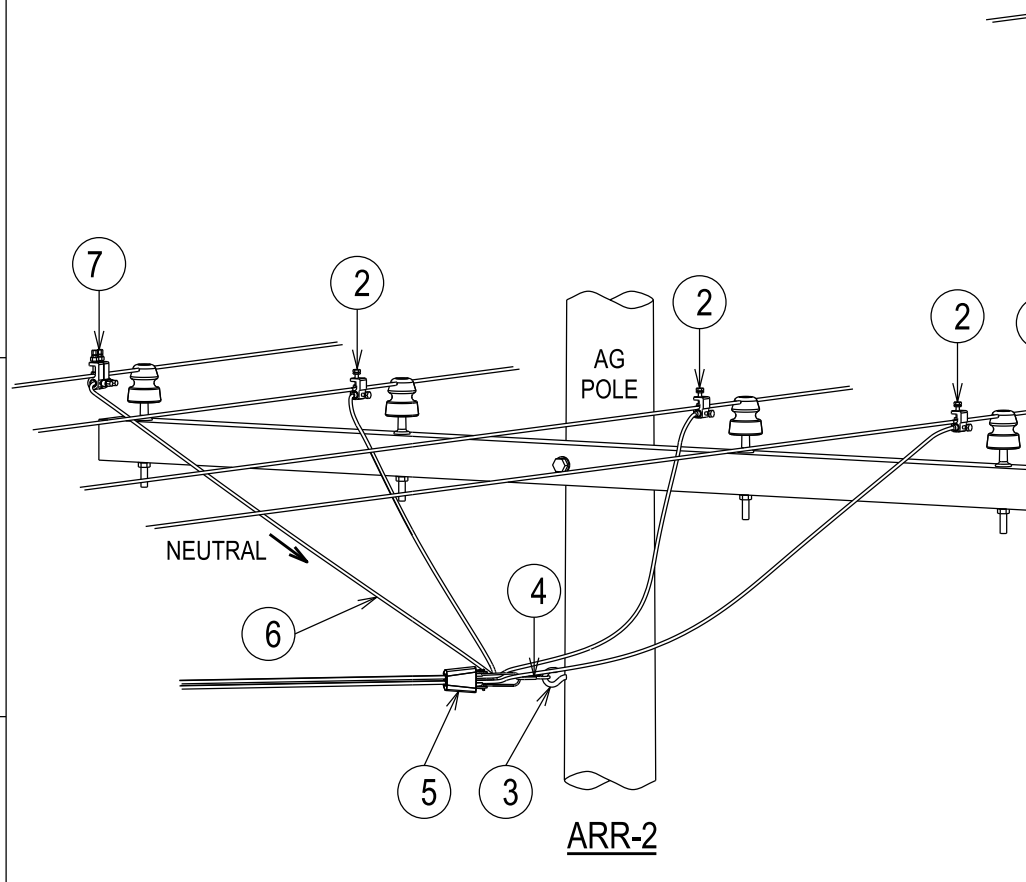


No.	DESCRIPTION	STOCK		QTY	
		AL	CU	ARR-1	ARR-2
1	CONDUCTOR - OVERHEAD	-	-	N/A	N/A
2	CONNECTOR - BARE MAINS/IPC	175051	H109694	3	3
3	HOOK - COACH SCREW M12x146	H75697	H75697	1	-
	HOOK - J SPIKE	1370	1370	-	1
4	LINK - WEAK CONNECTING 1.5kN	H81976	H81976	1	1
5	CLAMP - CABLE STRAIN 2-4 CORE 6-25mm ²	H102491	H102491	1	1
6	SERVICE CABLE - 4x25mm ² AL ABC, 4 CORE	H109280	H109280	A/R	A/R
7	CONNECTOR - SPLICE FOR NEUTRAL PHASE, BARE Al	182904	-	1	1
	CONNECTOR - SPLICE FOR NEUTRAL PHASE, BARE Cu	-	182905		

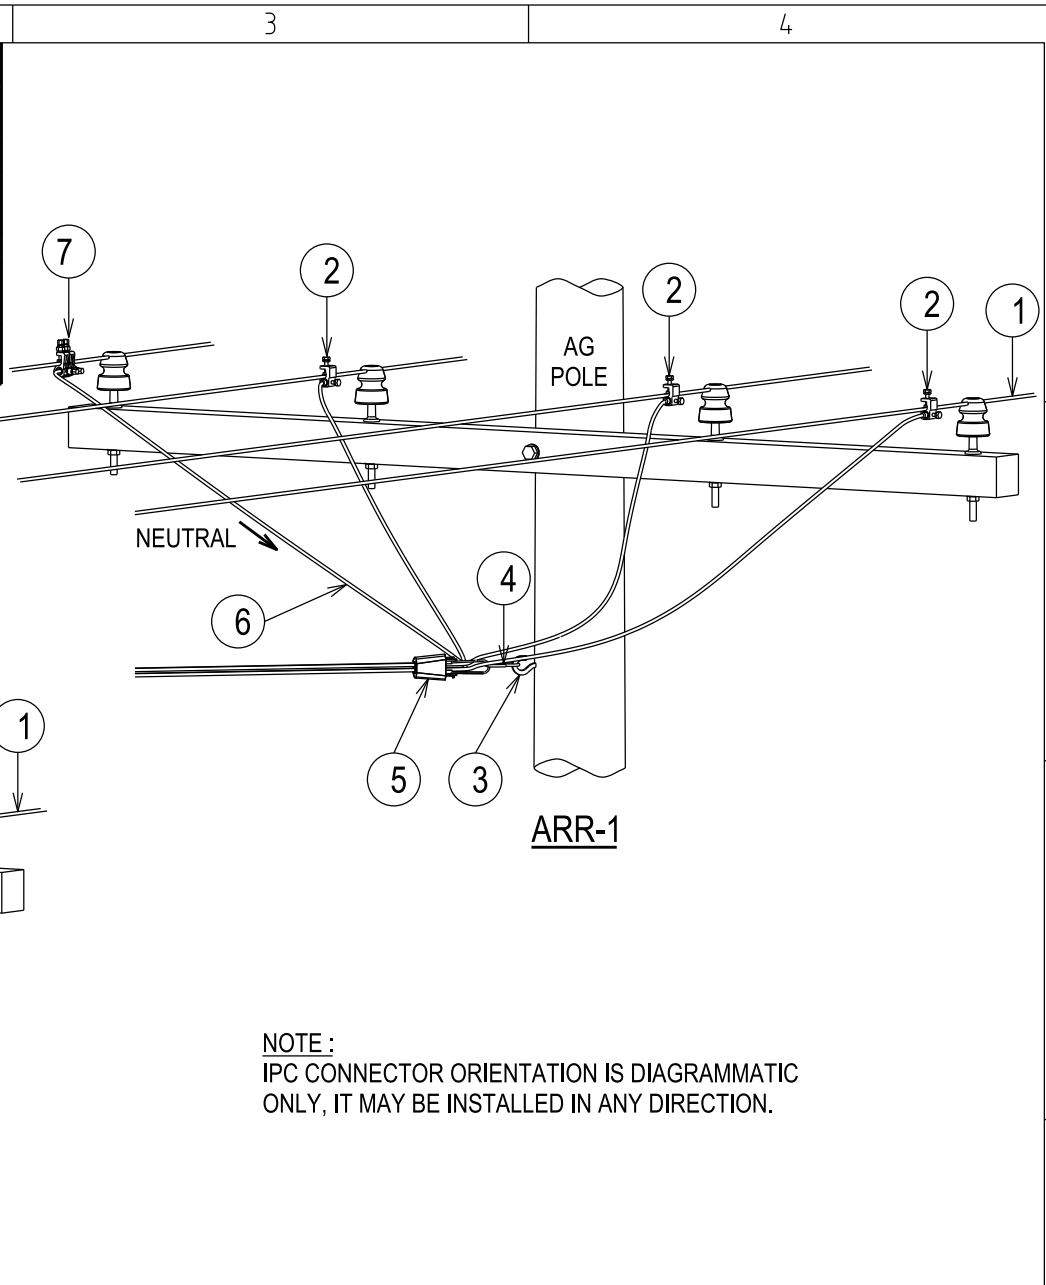

NOTE:
IPC CONNECTOR ORIENTATION IS DIAGRAMMATIC ONLY, IT MAY BE INSTALLED IN ANY DIRECTION.

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS	DWN: PATRICIA RIOS	5	APPD: MATTHEW CUPPLES
	CHKD: HIRI EHAMPARAM		
	DATE: 09/04/2014		
	NEUTRAL CONNECTION CHANGED, MATERIAL LIST AMENDED.		

NETWORK STANDARD

 145 NEWCASTLE RD
 WALLSEND NSW 2287
 PHONE: 4951 9388
 FAX: 4591 9389

DESIGNED	ROBERT KNOWLES
DRAWN	PATRICIA RIOS
CHECKED	ROBERT KNOWLES
AUTHORISED	GREG SKINNER
DATE	02/07/04
SCALE	NTS
MAP REF.	
LGA	

STANDARD CONSTRUCTION
 100AMP OPEN WIRE MAINS
 SUPPORT FROM POLE - 3 PHASE

PROJECT No.	NET-STD
PROJTRAK No.	-
Sheet 01 of 1 Sheets	
A4	152479
	5