




No.	DESCRIPTION	STOCK	QTY
1	CLAMP - CABLE STRAIN 4 CORE 25mm ² ABC	H102491	3
2	HOOK - COACH SCREW M12x146	H75697	2
3	LINK - WEAK CONNECTING	H81976	2
4	CONNECTOR - SPLICE, 25-95mm ² LV ABC/6-25mm ² Al/Cu, INSULATED SERVICE, INSULATION PIERCING	73593	10
5	ENDCAP - PUSH ON 25mm ²	H109447	4
6	CABLE IN - 4x25mm ² AL XLPE ABC, 4 CORE	H109280	A/R
7	CABLE OUT - 4x25mm ² AL XLPE ABC, 4 CORE	H109280	A/R

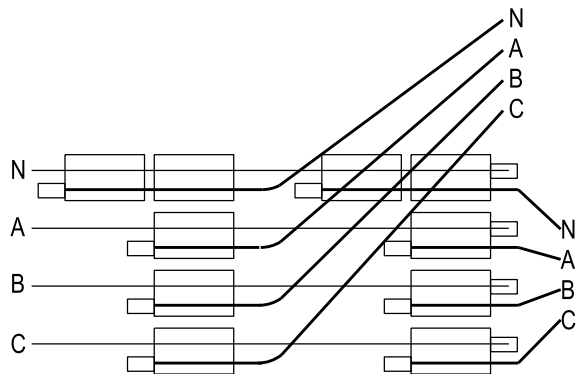

CONNECTION DIAGRAM

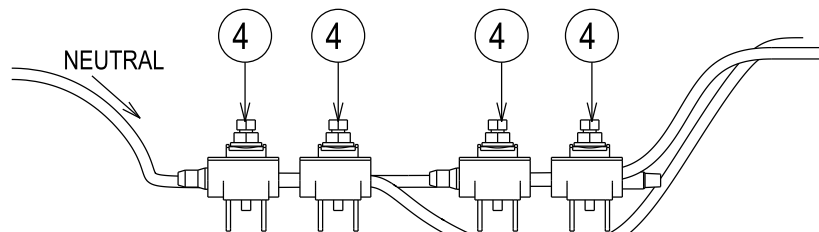

DETAIL 1

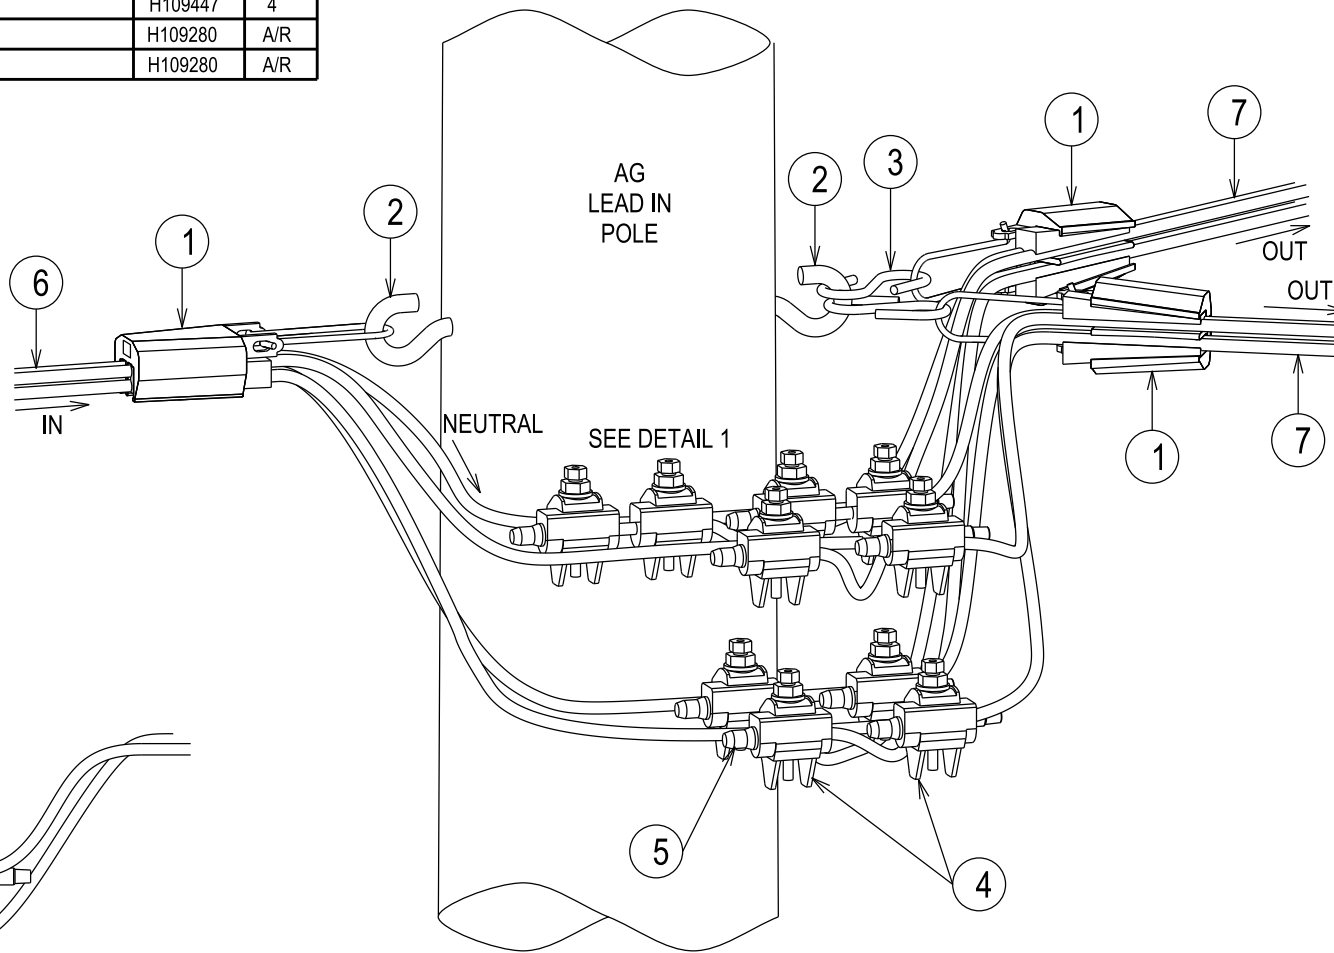

CAD DRAWING
DO NOT MANUALLY AMEND
AMENDMENTS
DWN: PATRICIA RIOS
CHKD: HIRI EHAMPARAM
DATE: 07/05/2014
NEUTRAL CONNECTION
CHANGED. MATERIAL
LIST & CONNECTION
DIAGRAM AMENDED.
DETAIL 1 ADDED.
APPD: MATTHEW CUPPLES

5

NETWORK STANDARD
Ausgrid
145 NEWCASTLE RD
WALLSEND NSW 2287
PHONE: 4951 9388
FAX: 4591 9389

DESIGNED	ROBERT KNOWLES
DRAWN	PATRICIA RIOS
CHECKED	ROBERT KNOWLES
AUTHORISED	GREG SKINNER
DATE	02/07/04
SCALE	NTS
MAP REF.	
LGA	

STANDARD CONSTRUCTION
100AMP AG LEAD IN POLE
TIMBER
4 CORE IN 2x100A 4 CORE OUT

PROJECT No. NET-STD

PROJTRAK No. -

Sheet 01 of 1 Sheets

A4 152489 5