



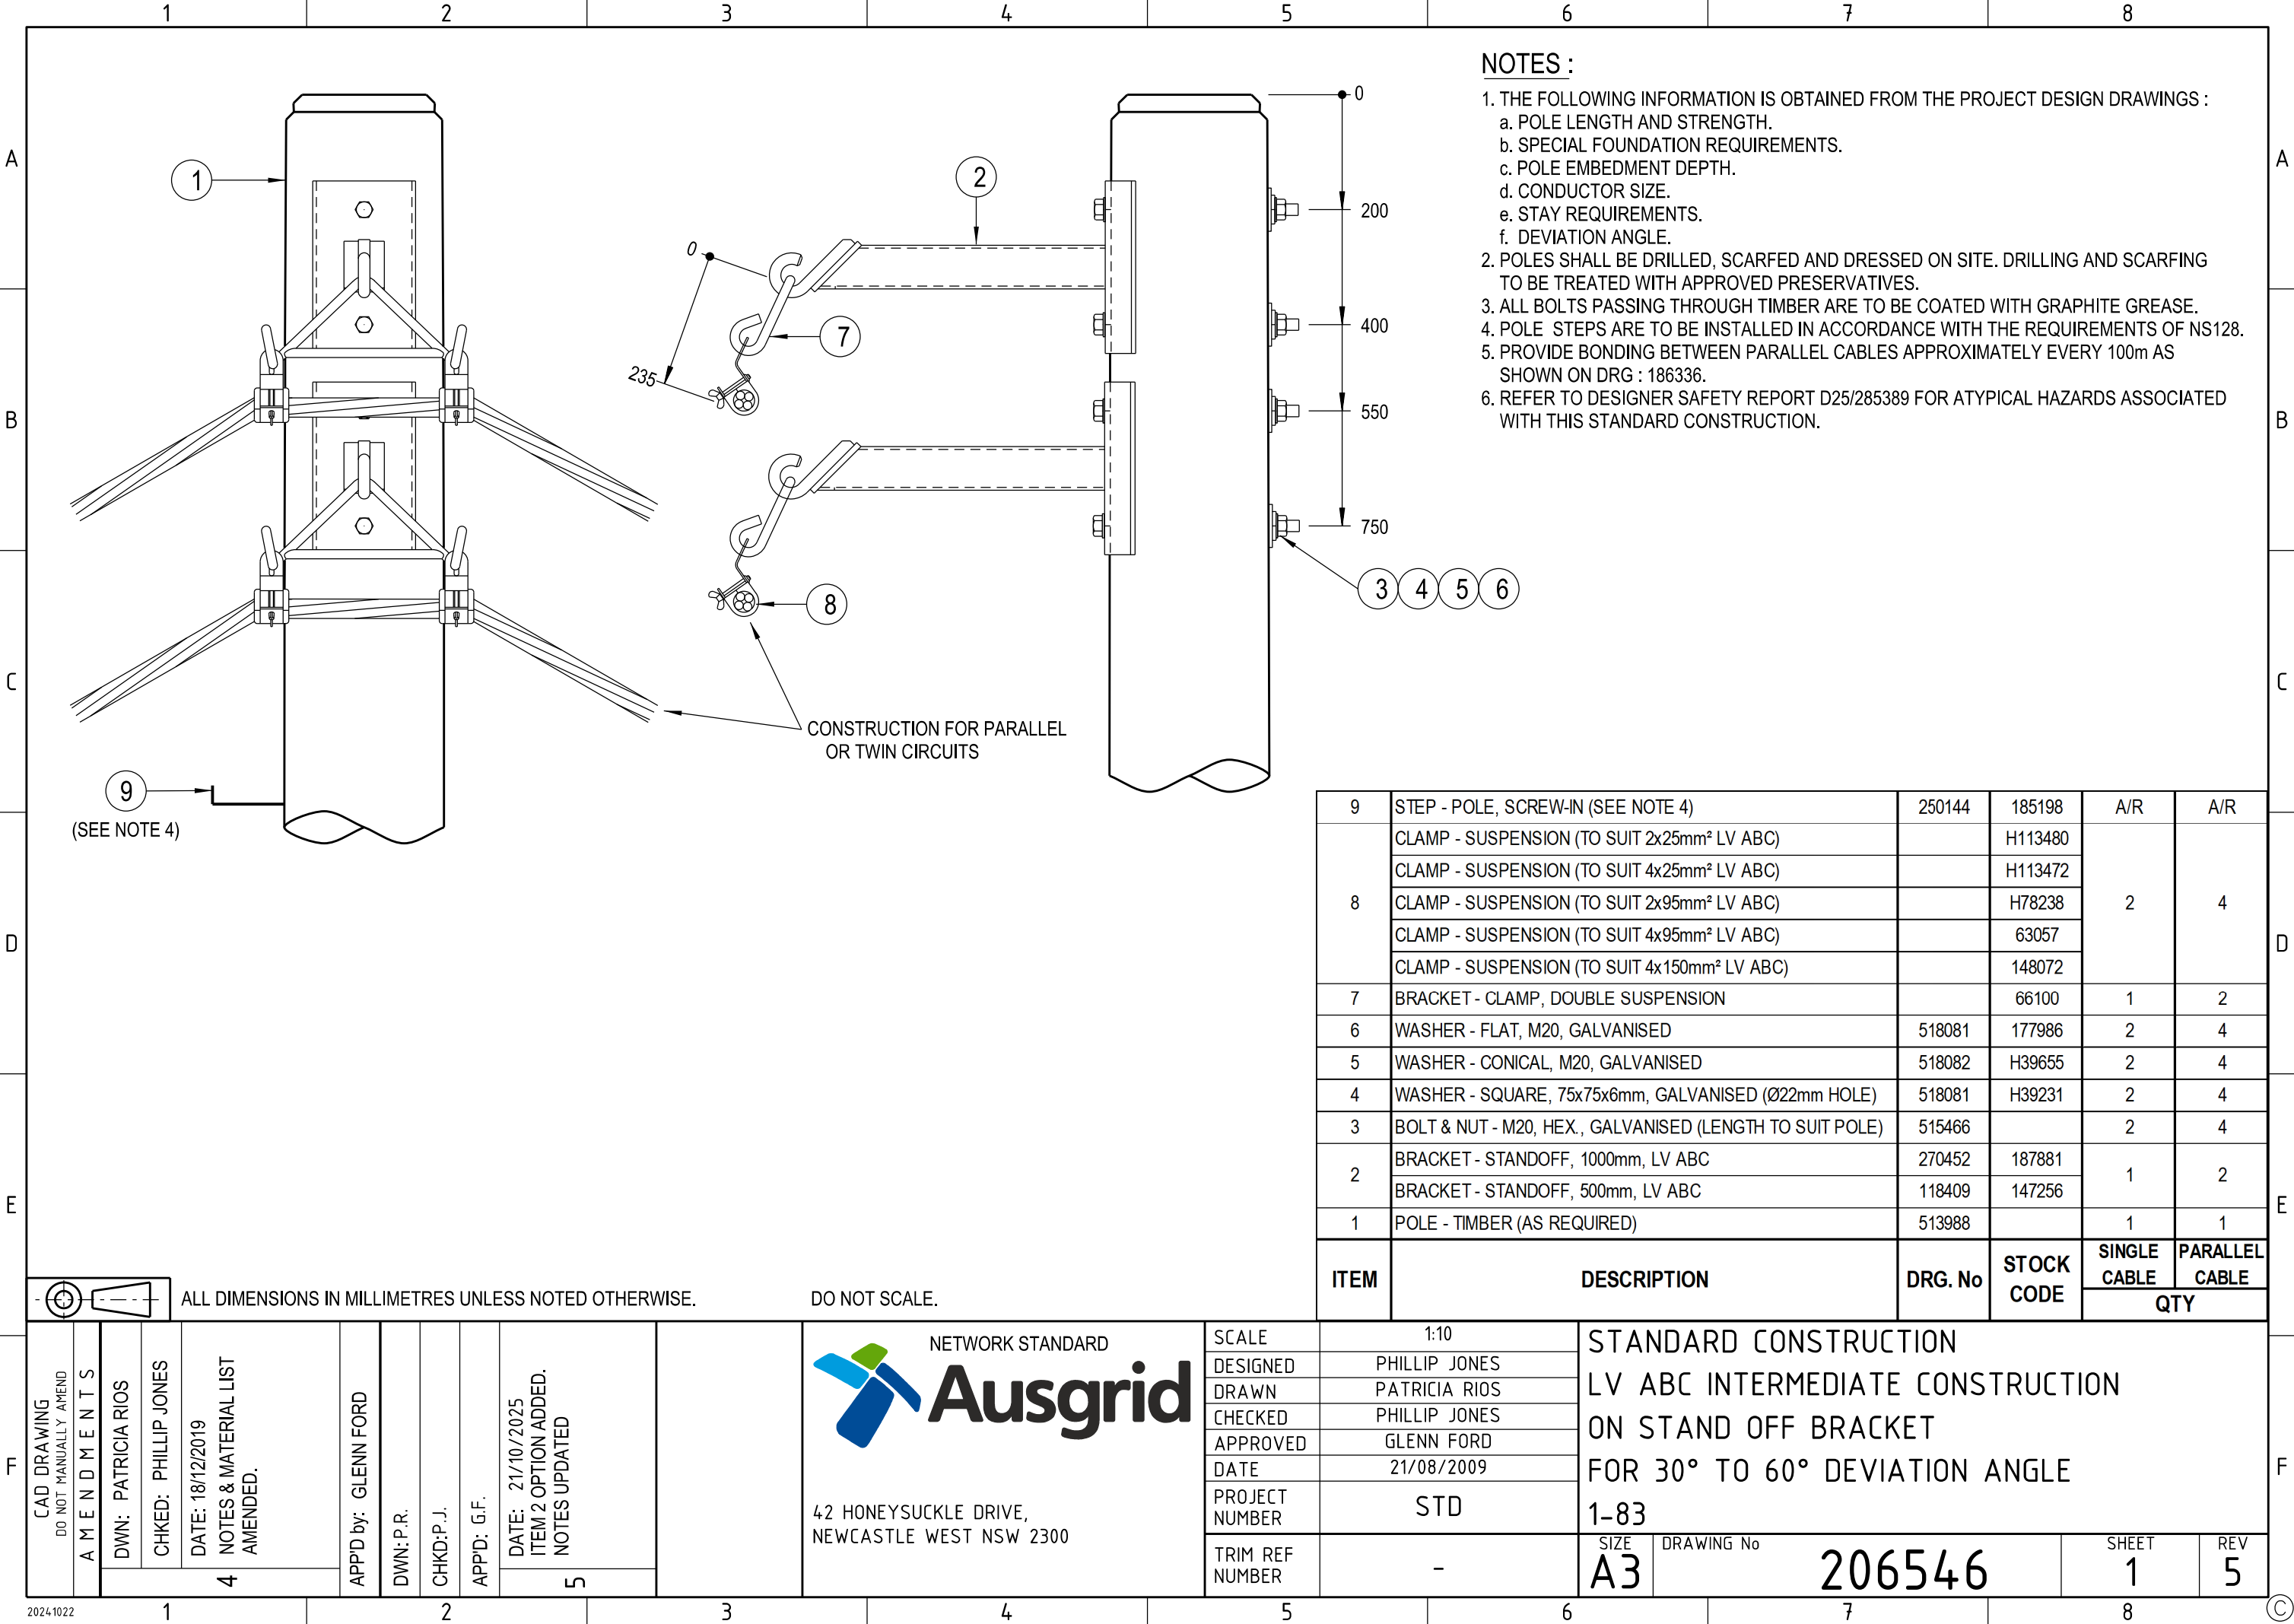

- NOTES :**
- 1. THE FOLLOWING INFORMATION IS OBTAINED FROM THE PROJECT DESIGN DRAWINGS :
 - a. POLE LENGTH AND STRENGTH.
 - b. SPECIAL FOUNDATION REQUIREMENTS.
 - c. POLE EMBEDMENT DEPTH.
 - d. CONDUCTOR SIZE.
 - e. STAY REQUIREMENTS.
 - f. DEVIATION ANGLE.
 - 2. POLES SHALL BE DRILLED, SCARFED AND DRESSED ON SITE. DRILLING AND SCARFING TO BE TREATED WITH APPROVED PRESERVATIVES.
 - 3. ALL BOLTS PASSING THROUGH TIMBER ARE TO BE COATED WITH GRAPHITE GREASE.
 - 4. POLE STEPS ARE TO BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NS128.
 - 5. PROVIDE BONDING BETWEEN PARALLEL CABLES APPROXIMATELY EVERY 100m AS SHOWN ON DRG : 186336.
 - 6. REFER TO DESIGNER SAFETY REPORT D25/285389 FOR ATYPICAL HAZARDS ASSOCIATED WITH THIS STANDARD CONSTRUCTION.

9	STEP - POLE, SCREW-IN (SEE NOTE 4)	250144	185198	A/R	A/R
8	CLAMP - SUSPENSION (TO SUIT 2x25mm² LV ABC)		H113480	2	4
	CLAMP - SUSPENSION (TO SUIT 4x25mm² LV ABC)		H113472		
	CLAMP - SUSPENSION (TO SUIT 2x95mm² LV ABC)		H78238		
	CLAMP - SUSPENSION (TO SUIT 4x95mm² LV ABC)		63057		
	CLAMP - SUSPENSION (TO SUIT 4x150mm² LV ABC)		148072		
7	BRACKET - CLAMP, DOUBLE SUSPENSION		66100	1	2
6	WASHER - FLAT, M20, GALVANISED	518081	177986	2	4
5	WASHER - CONICAL, M20, GALVANISED	518082	H39655	2	4
4	WASHER - SQUARE, 75x75x6mm, GALVANISED (Ø22mm HOLE)	518081	H39231	2	4
3	BOLT & NUT - M20, HEX., GALVANISED (LENGTH TO SUIT POLE)	515466		2	4
2	BRACKET - STANDOFF, 1000mm, LV ABC	270452	187881	1	2
	BRACKET - STANDOFF, 500mm, LV ABC	118409	147256		
1	POLE - TIMBER (AS REQUIRED)	513988		1	1
ITEM	DESCRIPTION	DRG. No	STOCK CODE	SINGLE CABLE	PARALLEL CABLE
				QTY	



ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE. DO NOT SCALE.

CAD DRAWING DO NOT MANUALLY AMEND	AMENDMENTS	DWN: PATRICIA RIOS CHKD: PHILLIP JONES DATE: 18/12/2019 4 NOTES & MATERIAL LIST AMENDED.	APP'D by: GLENN FORD DWN: P.R. CHKD: P.J. APP'D: G.F. DATE: 21/10/2025 ITEM 2 OPTION ADDED. NOTES UPDATED	5	NETWORK STANDARD Ausgrid 42 HONEYSUCKLE DRIVE, NEWCASTLE WEST NSW 2300	SCALE	1:10	STANDARD CONSTRUCTION LV ABC INTERMEDIATE CONSTRUCTION ON STAND OFF BRACKET FOR 30° TO 60° DEVIATION ANGLE 1-83			
						DESIGNED	PHILLIP JONES				
						DRAWN	PATRICIA RIOS				
						CHECKED	PHILLIP JONES				
						APPROVED	GLENN FORD				
F	20241022	1	2	3	4	5	6	7	8	9	10