


NS 171 DETAIL - APPENDIX B

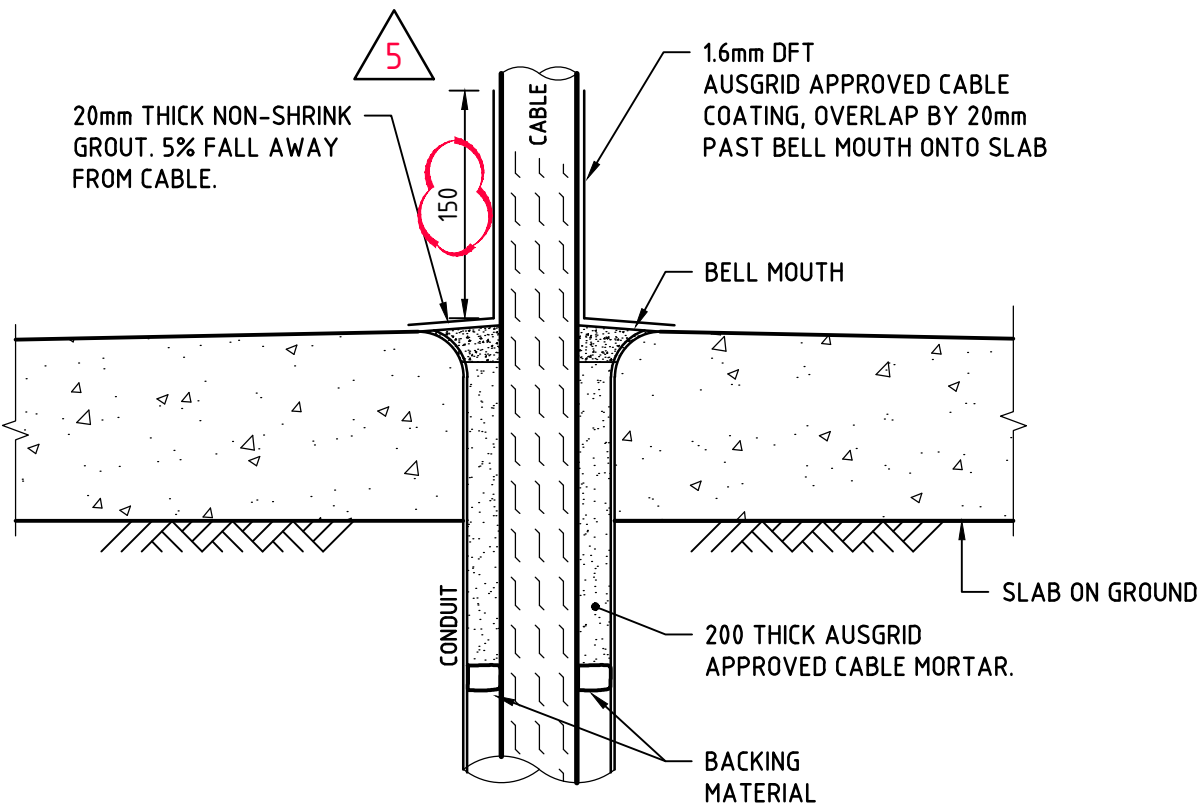

SECTION

NOTE:
FOR HV/LV POWER CABLES
ONLY (not for secondaries)

LIMITATIONS OF USE:

1. **DO NOT** USE IF (D² CABLE/D² CONDUIT) IS GREATER THAN 0.6 (60%)
WHERE D = DIAMETER. WHERE THIS OCCURS REFER TO DESIGN
BRANCH SYDNEY

A M E N D M E N T S

AMD	DATE	DESCRIPTION	NETWORK STANDARD	DESCRIPTION	DESIGNED BY	CHECKED BY	APPROVED BY
3	09.05.17	ISSUED FOR CONSTRUCTION, NOTE (SLAB ON GROUND) ADDED		B.B.	J.W.	K.G.	K.G.
4	22/12/2022	SECTION REVISED. ISSUED FOR CONSTRUCTION		JA	K.G.	P.L.	K.G.
5	18/05/2023	DIMENSION ADDED. ISSUED FOR CONSTRUCTION			A.V.	K.G.	K.G.



ISSUED FOR
CONSTRUCTION

SCALE	1:5
DESIGNED	-
DRAWN	JA
CHECKED	JW
APPROVED	JW
DATE	12/08/2008
TRIM REF	-

PROJECT NUMBER	ES 102-9
-------------------	----------

SIZE
A3

DRAWING No
190509

MORTAR SEAL
FOR OUTDOOR FLOOR
PENETRATIONS
SLAB ON GROUND

SHEET
1

AMD
5